


Water Use Intensity (WUI)					
	Potable (gal/yr)	NPW Flush (gal/yr)	NPW Irrigation (gal/yr)	Total Usage (including irrigation) (gal/yr)	WUI (gal/ft2/yr)
LEED Baseline	282,730	235,424	345,000	863,154	14.63
Design	203,350	149,783	345,000	698,133	11.83
Better	183,509	149,783	345,000	678,292	11.49
Best	183,509	129,724	345,000	658,233	11.15

Building SF 59,010

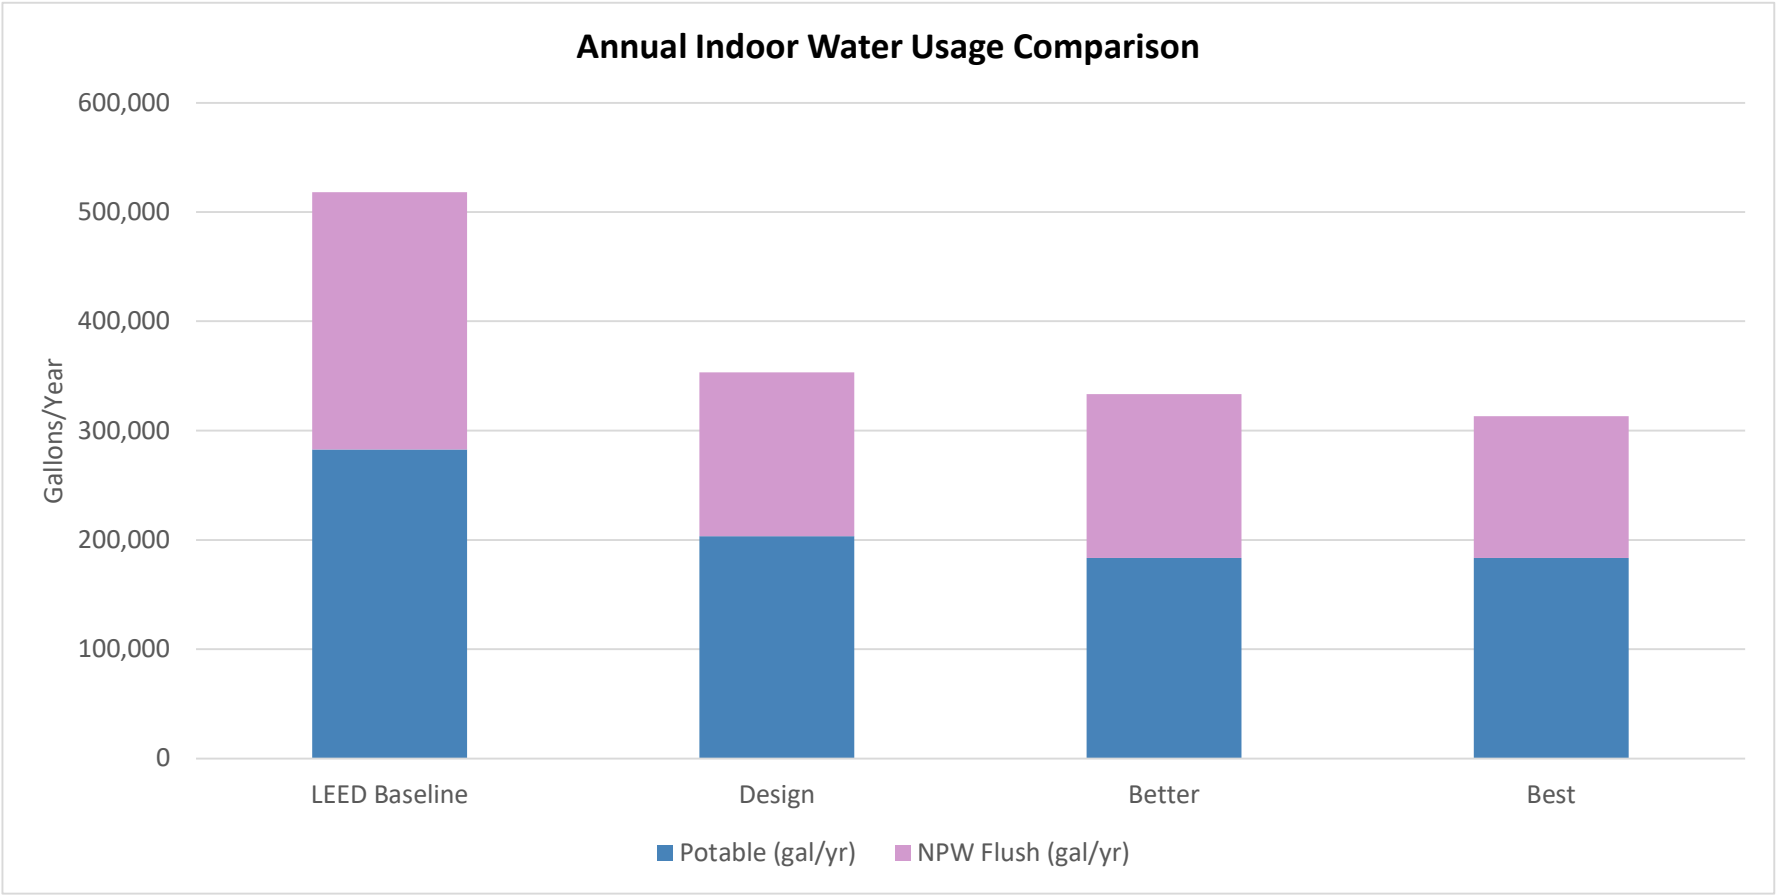

Fixture Flow Rates			
	Toilet	Urinal	Kitchen Sink
LEED Baseline	1.6	1	2.2
Design	1.28	0.125	1.5
Better	0.25	0.125	1.5
Best	1.1	0.125	1.5

Better+Reuse uses captured rainwater from the roof to supply NPW needs within the building.